

**Guidelines for Alternate Water Sources:
Indoor and Outdoor
Non-Potable Uses**

**Los Angeles County Department of Public Health
February 2016**

Table of Contents

- Basis for Developing These Guidelines 3**
- Indoor Water Uses 4**
 - Tier 1: Rainwater 5
 - Tier 2: Graywater 6
 - Tier 3: Stormwater 8
 - Tier 4: Recycled Water 10
- Outdoor Water Uses 11**
 - Tier 1: Rainwater 12
 - Tier 2: Graywater 14
 - Tier 3: Stormwater 16
 - Tier 4: Recycled Water 18
- Definitions and Acronyms 19**
- References 22**
- Endnotes 23**
- Acknowledgements 24**

BASIS FOR DEVELOPING THESE GUIDELINES

In moving toward a safe and sustainable water future for Los Angeles County we must learn to conserve water, replenish groundwater, and safely reuse water so that there is net zero water waste. There are many ways to approach this goal. Thanks to recent changes in State law, many opportunities now exist to reuse water safely. It is clear that if Los Angeles is to be successful in building a sustainable water future, we must learn to reduce the use of potable water (i.e. drinking water) for purposes such as flushing toilets, landscape irrigation, and washing clothes. One method to reduce the use of potable water for these tasks is to promote the safe use of alternate, non-potable water sources, such as rainwater, graywater, and stormwater. These alternate water sources can be used safely for a variety of indoor and outdoor uses, as long as public health requirements are met. To assist the public with information on how to collect and safely use alternate water sources, the Los Angeles County Department of Public Health (DPH), Environmental Health Division (EH) prepared this document, in collaboration with stakeholders, as a guide for the safe use of alternate water sources in indoor and outdoor settings. These guidelines are intended to provide a user-friendly roadmap for alternate water use; however, it is ultimately the responsibility of the system owner and operator to ensure that non-potable water sources are used appropriately and monitored for safety throughout the life of the project.

This document expands the work begun in 2011, when DPH published its guidance document on outdoor uses of alternate water sources and seeks to build on that work by incorporating the expanded types and uses of alternate water now permitted under State law. These Guidelines are divided into two sections; indoor use and outdoor use of alternate water sources. Under each of these two sections, the four alternate water sources are discussed: rainwater, graywater, stormwater, and recycled water. Each of these alternate water sources is represented in terms of a “tier.” Tier 1 represents rainwater; Tier 2, graywater; Tier 3, stormwater; and Tier 4, recycled water. Each tier has specific guidelines and requirements. The guidelines and requirements shall be reviewed annually and updated accordingly based on pertinent studies and research, or until the current federal, State or local regulations are superseded.

In reading this document, you will notice that Tier 1A systems intended for outdoor uses do not require the approval of DPH. However, please take note that all other systems, including Tier 1A systems intended to support indoor uses, do require the review and approval of DPH. Prior to final approval of Tier 1B, 2, 3, and 4 systems, DPH shall conduct project reviews to evaluate possible cross connection hazards between the domestic potable water supply and any alternate non-potable water systems, i.e., rainwater, graywater, stormwater and recycled water. These projects will be reviewed in conjunction with local building & safety departments and/or public works departments as these departments are the administrative authority referenced in the California Plumbing Code for such construction, and as such, EH recognizes their authority in granting joint approval for these types of projects.

If you have any questions regarding the approval process or these requirements, please contact the DPH EH Cross Connection and Water Pollution Control Section for additional information at (626) 430-5290 or visit our website www.publichealth.lacounty.gov/eh/.

Indoor Water Uses

INDOOR USES

TIER 1: RAINWATER

Rainwater capture systems may be used at single family dwellings, apartments (R1), hotels (R2), commercial, institutional, and municipal facilities. If the system will combine rainwater and graywater, it will be classified as Tier 2: Graywater.

Includes: Rainwater that is collected and used onsite.

Excludes: Stormwater, dry weather runoff, recycled water, and rainwater collected from locations zoned for manufacturing or industrial use.

Tier 1A: Non-Pressurized Rain Barrels/Cisterns

Indoor use of rainwater requires a specially designed gravity feed system in addition to a supplemental supply of potable water. Therefore, the guidelines for Tier 1B, below, need to be followed for indoor uses of rainwater.

Tier 1B: Pressurized Rainwater Catchment Systems

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting*
<ul style="list-style-type: none"> Toilet and urinal flushing Laundry washing Trap primers and cooling tower make-up 	<ul style="list-style-type: none"> Ch. 17 CPC E. coli < 100 CFU/100 ml, turbidity < 10 NTU or NSF 350 or CCR Title 22 Recycled Water Quality Equivalence at the point of use 	<ul style="list-style-type: none"> Ch. 17 CPC Table 1702.9.4 Prescreening & 100 µm filtration w/ disinfection Evaluated on a case-by-case basis per project 	<ul style="list-style-type: none"> Owner-Occupied Single Family Dwelling: Upon installation and change of ownership R1 & R2: Annually (Quarterly if used for laundry washing) Commercial/institutional/industrial: Annually (Quarterly if used for laundry washing) <p>*May suspend monitoring, report as non-operational, during quarters when dry.</p>
Requirements			
<ul style="list-style-type: none"> <input type="checkbox"/> Permits/approvals: <ul style="list-style-type: none"> Shall obtain a Building & Safety Building Permit from the local building authority Shall undergo a Public Health Review and Approval, including a Cross Connection Test, by DPH EH <input type="checkbox"/> Shall follow all applicable regulations governing dual plumbing systems <input type="checkbox"/> Shall incorporate failsafe designs and diversion to a protected potable source when treated water is out of specification¹ <input type="checkbox"/> Shall not be connected to any unprotected conveyance of potable water systems¹ <input type="checkbox"/> Shall be installed in accordance with manufacturer's instructions and installation requirements of the local building authority and of DPH. 			

Graywater systems may be used at single family dwellings, apartments (R1), hotels (R2), commercial, institutional, and municipal facilities.

Includes: “Graywater” that is collected and used onsite. Graywater systems may also use water from swimming pool backwash operations, air conditioner condensate, cooling tower-blow-down, steam system condensate, fluid cooler discharge water, food steamer discharge water, combination oven discharge water, industrial process water, fire pump test water, theme park recreation water operations, and foundation drainage. Systems that combine rainwater and graywater are classified as graywater systems.

Excludes: Stormwater, dry weather runoff (see instead Tier 3: Stormwater), and wastewater from kitchen sinks or toilets (see instead Tier 4: Recycled Water).

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting
<ul style="list-style-type: none"> Toilet and urinal flushing Laundry washing Trap primers and cooling tower make-up 	<ul style="list-style-type: none"> NSF 350 with disinfection <i>or</i> CCR Title 22 Recycled Water Quality Equivalence at the point of use <i>or</i> Other standard matching or exceeding presently accepted standards 	<ul style="list-style-type: none"> Packaged Units and/or Design Build Units – evaluated and complying with NSF 350 certification standard as a complete system Evaluated on a case-by-case basis per project 	<ul style="list-style-type: none"> Owner-Occupied, Single Family Dwelling: Upon installation and change of ownership R1 & R2: Annually (Quarterly if used for laundry washing) Commercial/institutional/industrial: Annually (Quarterly if used for laundry washing)

Requirements
<ul style="list-style-type: none"> <input type="checkbox"/> Permits/approvals: <ul style="list-style-type: none"> <input type="checkbox"/> Shall obtain Building & Safety Building Permit from the local building authority <input type="checkbox"/> Shall undergo Public Health Plan Review and Approval of the piping system, tanks, and pump, in order to reduce risk of cross connection with potable water supplies² <input type="checkbox"/> Non-NSF certified systems shall complete a 6 month demonstration phase showing water continually meets standard prior to treated graywater being used for any purpose other than subsurface irrigation <input type="checkbox"/> Non-NSF certified systems shall be certified to meet NSF 350 or other applicable water quality standard by a 3rd party tester approved by DPH EH <input type="checkbox"/> R1, R2, Commercial, Institutional, and Industrial systems including spray irrigation, outdoor water features, and vehicle washing must have manual developed by the engineer who designed the system identifying operation and maintenance of the system, online water quality <input type="checkbox"/> Shall be screened or be otherwise equipped to prevent vector intrusion <input type="checkbox"/> Shall incorporate failsafe designs to comply with failure sensing and signaling equipment standards in NSF 350³

- Shall incorporate diversion to a protected potable source when treated water is out of specification⁴
- Shall be equipped with an applicable overflow to an approved drainage system: wastewater typically draining to a sewer (e.g.) shall be plumbed to sewer, while wastewater typically draining to a storm drain, (e.g., foundation drainage) shall be plumbed to the storm drain
- Design and Build systems shall incorporate systems for the online monitoring of turbidity, pH, and Total Suspended Solids (TSS)
- Design and Build systems must have manual developed by the engineer who designed the system identifying operation and maintenance of the system, online water quality monitoring requirements, the water quality standards, sampling frequency, and procedures for response to different system failures
- Shall follow the same requirements as listed in Tier 1B
- Shall be installed in accordance with the manufacturer's instructions and installation requirements of local agencies

INDOOR USES

TIER 3: STORMWATER

Stormwater may be used at commercial, institutional, municipal, and industrial facilities only.

Includes: Stormwater and dry weather runoff collected from non-point sources. Stormwater may contain various contaminants: excess fertilizers, herbicides and insecticides from agricultural lands and residential areas; oil, grease and toxic chemicals from urban runoff and energy production; sediment from improperly managed construction sites, crop and forest lands, and eroding stream banks; salt from irrigation practices and acid drainage from abandoned mines; bacteria and nutrients from livestock, pet wastes and faulty septic systems; atmospheric deposition and hydromodification.

Excludes: Any water that has not entered a municipal stormwater system.

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting
<ul style="list-style-type: none"> Toilet and urinal flushing Trap primers and cooling tower make-up 	<ul style="list-style-type: none"> NSF 350 <i>or</i> CCR Title 22 Recycled Water Quality Equivalence at the point of use <i>or</i> Other standard matching or exceeding presently accepted standards and Meets all bacterial limits at point of use when distributed offsite and Meets California Maximum Contamination Levels, and the California Toxics Rule Standards 	<ul style="list-style-type: none"> Packaged Units and/or Design Build Units – evaluated and complying with NSF 350 certification standard as a complete system Specific treatment components shall be based on classification of chemical components during the first two years of operation Evaluated on a case-by-case basis per project 	<ul style="list-style-type: none"> Stormwater influent shall be tested to characterize chemical components after the first rain event of the rainfall year and at least two additional times during each rainfall year.⁵ Summary of stormwater analyses shall be maintained on premises Annual reporting of final water quality
Requirements <ul style="list-style-type: none"> <input type="checkbox"/> Permits/approvals: <ul style="list-style-type: none"> Shall obtain Building & Safety Building Permit from the local building authority Shall undergo Public Health Review and Approval⁶ Shall undergo review by Sanitation District for contaminants that may affect the wastewater treatment facility 			

- Non-NSF certified systems shall complete a 6 month demonstration phase showing water continually meets standard prior to being used for any purpose other than sub-surface irrigation
- Non-NSF certified systems shall be certified to meet NSF 350 or other applicable water quality standard by a 3rd party tester approved by DPH EH
- R1, R2, Commercial, Institutional, and Industrial systems including spray irrigation, outdoor water features, and vehicle washing must have manual developed by the engineer who designed the system identifying operation and maintenance of the system, online water quality
- Shall be screened or be otherwise equipped to prevent vector intrusion
- Shall incorporate failsafe designs to comply with failure sensing and signaling equipment standards in NSF 350³
- Shall incorporate diversion to a protected potable source when treated water is out of specification⁴
- Shall be equipped with an applicable overflow to an approved drainage system: wastewater typically draining to a sewer (e.g.) shall be plumbed to sewer, while wastewater typically draining to a storm drain, (e.g., foundation drainage) shall be plumbed to the storm drain
- Design and Build systems shall incorporate systems for the online monitoring of turbidity, pH, and Total Suspended Solids (TSS)
- Shall be installed in accordance with the manufacturer's installation instructions and installation requirements of local agencies
- A typical Tier 3 system for offsite collection may also require any of the following:
 - Storm drain diversion
 - Pre-treatment screening/sedimentation device
 - Pump station (where applicable)
 - Underground retention facility and disinfection facility (where applicable)
 - Recirculation system
 - Connection to distribution system
 - A supplemental water supply from a domestic source via an approved dedicated backflow prevention device

Recycled water may be used at commercial, institutional, municipal, industrial facilities, and limited R1 and R2 sites including professionally managed apartment complexes, condominium complexes, and hotels. The use of recycled water indoors at single-family dwellings and non-professionally managed apartments is currently not permitted.

Includes: “Recycled water” provided by a regulated recycled water agency.

Excludes: Blackwater treated through an Onsite Wastewater Treatment System and domestic wastewater *not* treated through a three-stage process.

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting
<ul style="list-style-type: none"> Toilet and urinal flushing Laundry washing Trap primers and cooling tower make-up Other uses pending DPH review (e.g., industrial processes) 	<ul style="list-style-type: none"> CCR Title 22 Recycled Water Quality Equivalence at point of use 	<ul style="list-style-type: none"> CCR Title 22 Recycled Water Quality Equivalence Additional treatment onsite to bring into compliance with water quality standards 	<ul style="list-style-type: none"> Permitted R1 & R2: Annually Commercial/institutional/industrial: Annually
Requirements			
<ul style="list-style-type: none"> <input type="checkbox"/> Permits/approvals: <ul style="list-style-type: none"> Shall obtain Building & Safety Building Permit from the local building authority Shall undergo Public Health Review and Approval Shall undergo review by the State Water Board <input type="checkbox"/> Shall incorporate failsafe designs to comply with failure sensing and signaling equipment standards in NSF 350³ <input type="checkbox"/> R1, R2, commercial, institutional, and industrial systems shall incorporate systems for the online monitoring of turbidity, pH, and Total Suspended Solids (TSS) <input type="checkbox"/> Shall incorporate diversion to a protected potable source when treated water is out of specification⁴ <input type="checkbox"/> Shall comply with all regulations and ordinances as applicable to tertiary treated recycled water under permit from the Regional Water Quality Control Board 			

Outdoor Water Uses

OUTDOOR USES

TIER 1: RAINWATER

Rainwater capture systems may be used at single-family dwellings, apartments (R1), hotels (R2), commercial, institutional, and municipal facilities.

Includes: Rainwater that is collected and used onsite.

Excludes: Stormwater, dry weather runoff, recycled water, and rainwater collected from locations zoned for manufacturing or industrial use.

Tier 1A: Non-Pressurized Rain Barrels/Cisterns

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting
<ul style="list-style-type: none"> • Surface or subsurface landscape irrigation • Vehicle washing 	<ul style="list-style-type: none"> • Not applicable 	<ul style="list-style-type: none"> • None required 	<ul style="list-style-type: none"> • None required
Requirements <ul style="list-style-type: none"> <input type="checkbox"/> Permits/approvals: <ul style="list-style-type: none"> ○ May need to obtain Building & Safety Building Permit for stability issues <input type="checkbox"/> Shall have a screened inflow opening, a spigot and/or hose bib, and an overflow pipe or equivalent <input type="checkbox"/> Shall be clearly labeled to indicate non-potable water use only <input type="checkbox"/> Shall not be connected to indoor/outdoor municipal potable plumbing, and shall not be pressurized or sprayed <input type="checkbox"/> Shall be installed in accordance with the rain barrel manufacturer's instructions, and installation requirements of local agencies 			

Tier 1B: Pressurized Rainwater Catchment Systems

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting*
<ul style="list-style-type: none"> • Drip and subsurface irrigation • Spray irrigation < 360 gallons storage • Vehicle washing 	<ul style="list-style-type: none"> • Not applicable 	<ul style="list-style-type: none"> • Ch. 17 CPC Table 1702.9.4 pre-screening • 100 µm filtration for car washing and drip irrigation 	<ul style="list-style-type: none"> • Not applicable
<ul style="list-style-type: none"> • Drip and subsurface irrigation • Vehicle washing • Spray irrigation ≥ 360 gallons storage • Non-interactive outdoor water feature 	<ul style="list-style-type: none"> • Ch. 17 CPC E. coli < 100 CFU/100 ml, turbidity < 10 NTU • <i>or</i> • NSF 350 with disinfection • <i>or</i> • CCR Title 22 Recycled Water Quality Equivalence at the Point of Use 	<ul style="list-style-type: none"> • Ch. 17 CPC Table 1702.9.4 prescreening and 100 µm filtration with disinfection • Evaluated on a case-by-case basis per project 	<ul style="list-style-type: none"> • Owner-Occupied Single Family Dwelling: Upon installation and change of ownership • R1 (e.g. apartments) & R2 (e.g. hotels): Annually • Commercial/institutional/industrial: Annually <p><small>*Monitoring and reporting frequencies may be suspended during quarters when cisterns are dry and shall be reported as non-operational. Frequencies shall be reevaluated periodically.</small></p>

Requirements
<ul style="list-style-type: none"> <input type="checkbox"/> Permits/approvals: <ul style="list-style-type: none"> ○ Shall obtain Building & Safety Building Permit from the local building authority ○ Shall undergo Public Health Review and Approval, including a Cross Connection Test, by DPH EH <input type="checkbox"/> Shall be equipped with an overflow device or rain diverter and be screened or otherwise equipped to prevent vector intrusion <input type="checkbox"/> Shall be installed in accordance with the manufacturer’s instructions, and installation requirements of local agencies

Graywater systems may be used at single-family dwellings, apartments (R1), hotels (R2), commercial, institutional, and municipal facilities.

Includes: “Graywater” refers to wastewater from bathtubs, showers, bathroom washbasins, clothes washing machines, and laundry tubs. Must be collected and used onsite. Also includes water from swimming pool backwash operations, air conditioner condensate, cooling tower-blow-down, steam system condensate, fluid cooler discharge water, food steamer discharge water, combination oven discharge water, industrial process water, fire pump test water, theme park recreation water operations, and foundation drainage. Includes a system that combines rainwater and graywater.

Excludes: Stormwater, dry weather runoff (see instead: Tier 3: Stormwater), and wastewater from kitchen sinks or toilets (see instead: Tier 4: Recycled Water).

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting
UNTREATED <ul style="list-style-type: none"> Mulch basin or subsurface irrigation 	<ul style="list-style-type: none"> Not applicable 	<ul style="list-style-type: none"> Pre-screening 	<ul style="list-style-type: none"> Not applicable
TREATED <ul style="list-style-type: none"> As above Spray and drip irrigation Non-interactive outdoor water feature Vehicle washing 	<ul style="list-style-type: none"> NSF 350 with disinfection <i>or</i> Title 22 Recycled Water Quality Equivalence 	<ul style="list-style-type: none"> Packaged Units and/or Design Build Units shall be NSF 350 Certified as a complete system Evaluated on a case-by-case basis per project 	<ul style="list-style-type: none"> Owner-Occupied Single-Family Dwelling: Upon installation and change of ownership R1 (apartments) & R2 (hotels): Annually Commercial/institutional/industrial: Annually

Requirements
<ul style="list-style-type: none"> <input type="checkbox"/> Permits/approvals: <ul style="list-style-type: none"> <input type="checkbox"/> Shall obtain Building & Safety Building Permit from the local building authority <input type="checkbox"/> Shall undergo Public Health Review and Approval, or equivalent approval by the appropriate local agency of the piping system, tanks, and pump, where applicable, in order to reduce risk of cross connection with potable water supplies <input type="checkbox"/> Shall be screened or be otherwise equipped to prevent vector intrusion <input type="checkbox"/> Shall incorporate failsafe designs to comply with failure sensing and signaling equipment standards in NSF 350⁷ <input type="checkbox"/> Shall incorporate diversion to a protected potable source when treated water is out of specification⁴ <input type="checkbox"/> Shall be equipped with an applicable overflow to an approved drainage system: wastewater typically draining to a sewer (e.g.) shall be plumbed to sewer, while wastewater typically draining to a storm drain, (e.g. foundation drainage) shall be plumbed to the storm drain

- R1, R2, Commercial, Institutional, and Industrial systems including spray irrigation, outdoor water features, and vehicle washing shall include online monitoring for turbidity, pH, and TSS
- R1, R2, Commercial, Institutional, and Industrial systems including spray irrigation, outdoor water features, and vehicle washing must have manual developed by the engineer who designed the system identifying operation and maintenance of the system, online water quality monitoring requirements, the water quality standards, sampling frequency, and procedures for response to different system failures
- Shall follow the same requirements as listed in Tier 1B
- Shall be installed in accordance with the manufacturer's instructions and installation requirements of local agencies

OUTDOOR USES

TIER 3: STORMWATER

Stormwater may be used at commercial, institutional, municipal, and industrial facilities only.

Includes: Stormwater and dry weather runoff collected from non-point sources. Stormwater may contain various contaminants: excess fertilizers, herbicides and insecticides from agricultural lands and residential areas; oil, grease and toxic chemicals from urban runoff and energy production; sediment from improperly managed construction sites, crop and forest lands, and eroding stream banks; salt from irrigation practices and acid drainage from abandoned mines; bacteria and nutrients from livestock, pet wastes and faulty septic systems; atmospheric deposition and hydromodification.

Excludes: Any water that has not entered a municipal stormwater system.

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting
<ul style="list-style-type: none"> Mulch basin, drip, and subsurface irrigation 	<ul style="list-style-type: none"> California Maximum Contamination Levels, and the California Toxics Rule Standards 	<ul style="list-style-type: none"> Package Units and/or Design Build Units evaluated on a case-by-case basis per project 	<ul style="list-style-type: none"> Stormwater influent shall be tested to characterize chemical components after the first rain event of the rain fall year and at least two additional times during each rain fall year.⁵ Summary of stormwater analyses shall be maintained on premises Annual reporting of final water quality
<ul style="list-style-type: none"> As above Spray irrigation Non-interactive outdoor water feature Vehicle washing Street sweeping Dust control 	<ul style="list-style-type: none"> NSF 350, if sprayed or CCR Title 22 Recycled Water Quality Equivalence at the Point of Use and Meets all bacterial limits at point of use when distributed offsite And Meets California Maximum Contamination Levels, and the California Toxics Rule Standards 	<ul style="list-style-type: none"> Packaged Units and/or Design Build Units shall be NSF 350 Certified as a complete system Evaluated on a case-by-case basis per project 	

Requirements

- Permits/approvals:
 - Shall obtain Building & Safety Building Permit from the local building authority
 - Shall undergo Public Health Review and Approval
 - May require review by Regional Water Quality Control Board for contaminants that may affect the groundwater quality

- Non-NSF certified systems shall complete a 6 month demonstration phase showing water continually meets standard prior to being used for any purpose other than sub-surface irrigation
- Non-NSF certified systems shall be certified to meet NSF 350 or other applicable water quality standard by a 3rd party tester approved by the department
- R1, R2, Commercial, Institutional, and Industrial systems including spray irrigation, outdoor water features, and vehicle washing must have manual developed by the engineer who designed the system identifying operation and maintenance of the system, online water quality
- Shall be screened or be otherwise equipped to prevent vector intrusion
- Shall incorporate failsafe designs to comply with failure sensing and signaling equipment standards in NSF 350⁸
- Shall incorporate diversion to a protected potable source when treated water is out of specification⁴
- Shall be equipped with an applicable overflow device
- A typical Tier 3 system for offsite collection may also require any of the following:
 - Storm drain diversion
 - Pre-treatment screening/sedimentation device
 - Pump station (where applicable)
 - Underground retention facility and disinfection facility (where applicable)
 - Recirculation system
 - Connection to distribution system
 - A supplemental water supply from a domestic source via an approved dedicated backflow prevention device
- Shall be installed in accordance with the manufacturer's instructions and installation requirements of local agencies
- Additional requirements may apply. Check with local regulatory agencies for further information

OUTDOOR USES

TIER 4: RECYCLED WATER

Recycled water can be used by single-family dwellings, R1 (e.g. apartments), R2 (e.g. hotels), commercial, institutional, and industrial facilities.

Includes: “Recycled water” provided by a regulated recycled water agency.

Excludes: Blackwater treated through an onsite wastewater treatment system and domestic wastewater *not* treated through a three-stage process.

Allowed Uses	Min. Water Quality Standard	Treatment Process	Monitoring & Reporting
<ul style="list-style-type: none"> • Drip, spray, and subsurface irrigation • Non-interactive outdoor water feature • Street sweeping⁸ • Dust control⁹ • Other uses pending DPH review (e.g., vehicle washing) 	<ul style="list-style-type: none"> • CCR Title 22 Recycled Water <i>and</i> • All bacterial limits met at the point of use for spray irrigation 	<ul style="list-style-type: none"> • CCR Title 22 Recycled Water 	<ul style="list-style-type: none"> • Owner-Occupied Single-Family Dwelling: Annually • R1 & R2: Annually • Commercial/institutional/industrial: Annually
Requirements			
<ul style="list-style-type: none"> <input type="checkbox"/> Permits/approvals: <ul style="list-style-type: none"> ○ Shall obtain Building & Safety Building Permit from the local building authority ○ Shall undergo Public Health Review and Approval by DPH EH ○ Shall undergo review by the State Water Board ○ Shall undergo review by other local agencies as applicable <input type="checkbox"/> Shall incorporate failsafe designs to comply with failure sensing and signaling equipment standards in NSF 350⁸ <input type="checkbox"/> Shall incorporate diversion to a protected potable source when treated water is out of specification⁴ <input type="checkbox"/> Shall comply with all regulations and ordinances as applicable to tertiary treated recycled water under permit from Regional Water Quality Control Board 			

DEFINITIONS AND ACRONYMS

Alternate non-potable water supply: A non-potable source of water which includes graywater, rainwater, stormwater, dry weather runoff, onsite treated water (non-potable), and recycled/reclaimed water. Alternate water sources include but are not limited to swimming pool backwash operations, air conditioner condensate, cooling tower blow-down water, steam system condensate, fluid cooler discharge water, food steamer discharge water combination oven discharge water, industrial process water, and fire pump test water, theme park recreation water operations, foundation drainage, and onsite dry weather runoff.

Blackwater: Wastewater containing bodily or other biological wastes, as from toilets, dishwashers, or kitchen drains, and kept separate from graywater in wastewater recycling systems.

Backflow: The undesirable reversal of flow of water or mixtures of water and other liquids, gases or other substances into the distribution pipes of the potable supply of water from any source or sources

CCR: California Code of Regulations.

CFU: Colony Forming Units.

Cistern: A component of a rainwater/stormwater catchment system for storing rainwater/stormwater for the purpose of using the water for non-potable uses.

CPC: California Plumbing Code.

Cross Connection: Any actual or potential connection or structural arrangement between a public or a consumer's potable water system and any other source or system through which it is possible to introduce into any part of the potable system any used water, industrial fluid, gas, or substance other than the intended potable water with which the system is supplied.

DPH EH: Los Angeles County Department of Public Health, Environmental Health Division.

Drip irrigation: An irrigation method allowing water to drip slowly to the roots of plants, either onto the soil surface or directly onto the root zone, through a network of valves, pipes, tubing, and emitters.

Dry weather runoff water: Non-potable water, harvested from a municipal storm water system during dry weather from runoff which flows when potable water is wasted or used inefficiently, and that discharges to waters of the U.S. This does not include water from a combined sewer or from a Publicly Owned Treatment Works (POTW).

Graywater: Untreated wastewater that has not been contaminated by any toilet discharge, has not been affected by infectious, contaminated, or unhealthy bodily wastes, and does not present a threat from contamination by unhealthful processing, manufacturing, or operating wastes.

Graywater includes, but not limited to, wastewater from domestic activities such as bathtubs, showers, bathroom washbasins, clothes washing machines, laundry tubs, but does not include wastewater from toilets, kitchen sinks and dishwashers.

Harvested rainwater: Rainwater that is collected from roofs of buildings and other (e.g. at grade) impervious surfaces, and does not leave the land parcel where it was collected.

Health Officer: The health officer of the county of Los Angeles, or his duly authorized representative.

Hydromodification: Alteration of the natural flow of water through a landscape, and often takes the form of channel modification or channelization. Hydromodification is one of the leading sources of impairment in streams, lakes, estuaries, aquifers, and other water bodies in the United States.

Industrial process water: Wastewater from industrial or commercial processes that has not been contaminated by any toilet discharge, infectious, bodily wastes, or by processing, manufacturing or operating wastes.

MS4: A municipal separate storm sewer system or of conveyances owned by a State, city, or other public entity that discharges to waters of the U.S. and is designed or used for collecting or conveying stormwater. MS4 does not include a combined sewer and is not part of a Publicly Owned Treatment Works (POTW).

Non-interactive outdoor water feature: Fountains, waterfalls, or other features not intended to act as play zones for children.

Non-point source: A source of pollution that issues from widely distributed or pervasive environmental elements, and does not have a distinct point of production or origin, such as a storm drain outlet at the beach, part of the storm drain system. Point sources include POTWs and power plants.

Non-potable cistern catchment system: A system using cisterns to collect harvested rainwater/stormwater from a rain event or from dry weather runoff. Cisterns in Los Angeles County may serve as a secondary source of non-potable water for applications that do not require potable water, such as landscape irrigation and indoor flushing, which can dramatically lower potable water demand and reduce offsite rainfall runoff.

Non-potable water: Water which is not intended for human or animal consumption.

NSF: National Sanitation Foundation.

NTU: Nephelometric Turbidity Units

Onsite treated non-potable water: Non-potable water that has been collected, treated, and intended to be used onsite and is suitable for direct beneficial use. Sources for onsite treated non-potable water include, but are not limited to, graywater, rainwater, stormwater, recycled water, reclaimed water, cooling tower blow-down water, condensate, and foundation drainage.

Potable water: Water which is fit for consumption by humans. The United States Environmental Protection Agency (EPA) identifies biological and chemical contaminants in drinking water that occur at levels that may adversely affect public health. The EPA establishes Maximum Contaminant Levels (MCLs) permissible in drinking water, which become enforceable standards.

Publicly Owned Treatment Works: A system owned and operated by a State, County or local government designed to provide secondary or tertiary treatment to sewage in order to reduce the number of pathogenic bacteria, and the components of the sewage that promote bacterial growth, such as Nitrogen, Biological Oxygen demand, and Total Suspended Solids to allow the waste effluent to be disposed of safely in the environment.

R1 & R2: Multi-unit residential occupancies. R1 – minimal stay (i.e., hotels, motels, bed and breakfast homes); R2 – long-term stay (i.e., dormitories, employee use, apartment houses).

Rain barrel: A container that collects rainwater that falls directly into the container or that is collected by an above ground collection system that prevents the collected water from contacting the ground. Rain barrels are connected to gravity flow systems only, and typically each rain barrel contains 55 gallons of water, more or less, but multiple rain barrels may be connected to increase water collection volume.

Rainwater: Precipitation on any public or private parcel that has not entered an offsite storm drain system or channel, a flood control channel, or any other stream channel.

Recycled water: Treated wastewater from sewage treatment plants to produce high quality non-potable water that is suitable for a range of non-drinking purposes. Recycled water meets California Department of Public Health statewide uniform criteria for disinfected tertiary treated wastewater.

Stormwater: Rainwater that has left a distinct parcel and entered a municipal storm water system or conveyances owned by a State, city, or other public entity that collects rainwater that discharges to waters of the U.S. This water does not include water from a combined sewer or from a Publicly Owned Treatment Works (POTW).

Subsurface irrigation: Irrigation field installed either below finish grade within the top soil, in a trench below the layer of top soil, or below a mulch bed at least two (2) inches deep.

VOCs: Volatile organic compounds.

REFERENCES

Referenced code sections:

- California Code of Regulations Title 22, Chapter 15, Article 4; Chapter 3 and Title 24 (California Plumbing Code), Part 5, Chapters 2, 6, 16 and 17; as adopted by Los Angeles County as Title 28
- California Health & Safety Code, Section 116800
- California Health and Safety Code, Chapter 4, California Safe Drinking Water Act
- Federal Register: December 1992, Part 2. 40 Code of Federal Regulations Part 131 Water Quality Standards; Establishment of Numeric Criteria for Priority Toxic Pollutants; States' Compliance; Final Rule. A.K.A. California Toxics Rule

Other references:

Chau, Haan-Fawn, "Green Infrastructure for Los Angeles: Addressing Urban Runoff and Water Supply Through Low Impact Development," University of California School of Public Affairs, April 17, 2009.

Bellomo, Angelo J., "Rainwater Harvesting Policy 515.07," Los Angeles County Department of Public Health, January 25, 2010.

"Rainwater Catchment Design and Installation Standards," American Rainwater Catchment Systems Association, 2010.

"Rainwater Harvesting Design Standard 63, ANSI/ASPE/ARCSA, 2013.

"Stormwater Harvesting Design Standard 78, ANSI/ASPE/ARCSA, 2015.

"Green Plumbing & Mechanical Code Supplement," International Association of Plumbing and Mechanical Officials, 2010 rev.

"Rainwater Collection Systems (Cisterns)," Ventura County Resource Management Agency, 2006.

"Capturing Rainwater from Rooftops: An Efficient Water Resource Management Strategy that Increases Supply and Reduces Pollution," NRDC, 2011.

ENDNOTES

¹ A dedicated supply of potable water protected by an approved backflow assembly is allowed to be connected downstream of the cistern pump to supply water to the designed application.

² Manufacturer's instructions are written to apply to a general clientele and may require additional conditions for approval, therefore a plan review by Public Health and the local Building & Safety Department is also necessary.

³ Specifically: NSF 350 sections 5.8.1, 5.8.2, 5.8.3, and 5.8.4, and flow design standards in sections 5.9. NSF 350 standards require a mechanism or process capable of detecting failures of electrical or mechanical components critical to the treatment processes and detecting high water condition. In the event of a detected failure or high water condition, a visual and audible alarm is required that operate even in the event of an electrical, mechanical, or hydraulic malfunction of the system. In addition, commercial systems require telemetric alarms by phone or email to the owner operator. For reuse treatment systems a bypass for discharge of untreated wastewater to the sewer system shall be present and shall be activated automatically in the event of a malfunction. The system shall also possess a means to control the volume of water in the systems and prevent the overflow to any location other than a locally approved water treatment and disposal system.

⁴ A dedicated supply of potable water protected by an approved Reduced Pressure Principle Backflow Assembly (RP) is allowed to be connected to the non-pressurized storage tank (treated) and/or surge tank.

⁵ A rainfall event is defined as 1/10th of an inch, as measured at the University of Southern California Monitoring Station, information available at Los Angeles County Department of Public Works webpage <http://www.ladpw.org/wrd/precip/>. The rainfall year is from July 1 through June 30, per the National Weather Service.

⁶ The Tier 3 water qualities will be reviewed case by case by Los Angeles County Department of Public Health, Los Angeles Regional Water Quality Control Board, and other local agencies as applicable. Other water quality standards being developed at the time of the writing of this guidance document shall be considered once the standard has been accepted by the Public Health Agency having Jurisdiction, i.e. IAPMO Z1002 and IAPMO Z1207.

⁷ Specifically: NSF 350 sections 5.8.1, 5.8.2, 5.8.3, and 5.8.4.

⁸ Both commercial and industrial allowed.

ACKNOWLEDGEMENTS


The Los Angeles County Department of Public Health would like to thank the following organizations that contributed to the development of these guidelines:

City of Los Angeles Bureau of Sanitation/WPD
City of Santa Monica Office of Sustainability & the Environment
Heal the Bay
Natural Resources Defense Council
State Water Board Drinking Water Division
TreePeople



Approved by:
Terri S. Williams, REHS
Acting Director of Environmental Health

Date

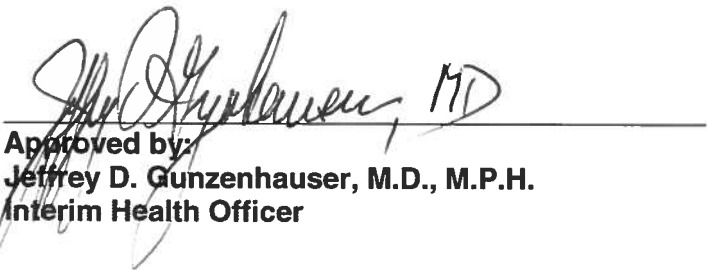

Approved by:
Jeffrey D. Gunzenhauser, M.D., M.P.H.
Interim Health Officer

Feb 11, 2016

Date